




Single Family Residential 3/4" & 1" Interior Meter Installation Request Form

INSTALLATION CRITERIA NOTES

1. Curb stop box plumb, operational, and set to finish grade.
2. Dual check assembly installed directly adjacent to the downstream side of the downstream shut-off valve. (See drawing).
3. 1-inlet and 1-outlet shut-off valve immediately adjacent to water meter setter.
4. Meter setter installed and stabilized in the horizontal position, 24-48" above the finished floor.
5. Meter setter has a minimum 3" clearance from the wall and 12" around the meter setter, with clear access from the front.
6. Meter setter in a crawl space is located within 3' of the access and a minimum of 18" below the floor joist. Provisions are made to prevent freezing in unheated spaces.
7. FCLWD meter lay lengths - 3/4" meter = 7.5", 1" meter = 10.75"
8. Maximum 70' of 1/2" rigid, metallic conduit, no junction boxes, furnished with pull line.
9. Conduit is adjacent and stabilized from the ceiling to the meter setter, terminating 2-3" directly above the setter.
10. Recessed electrical box mounted 48-66" above final grade, with a minimum of a 8" square flat wall space for the District radio unit.
11. District radio location shall not be located on the rear of the structure.
12. No leaks.
13. Home accessible to meter installer.

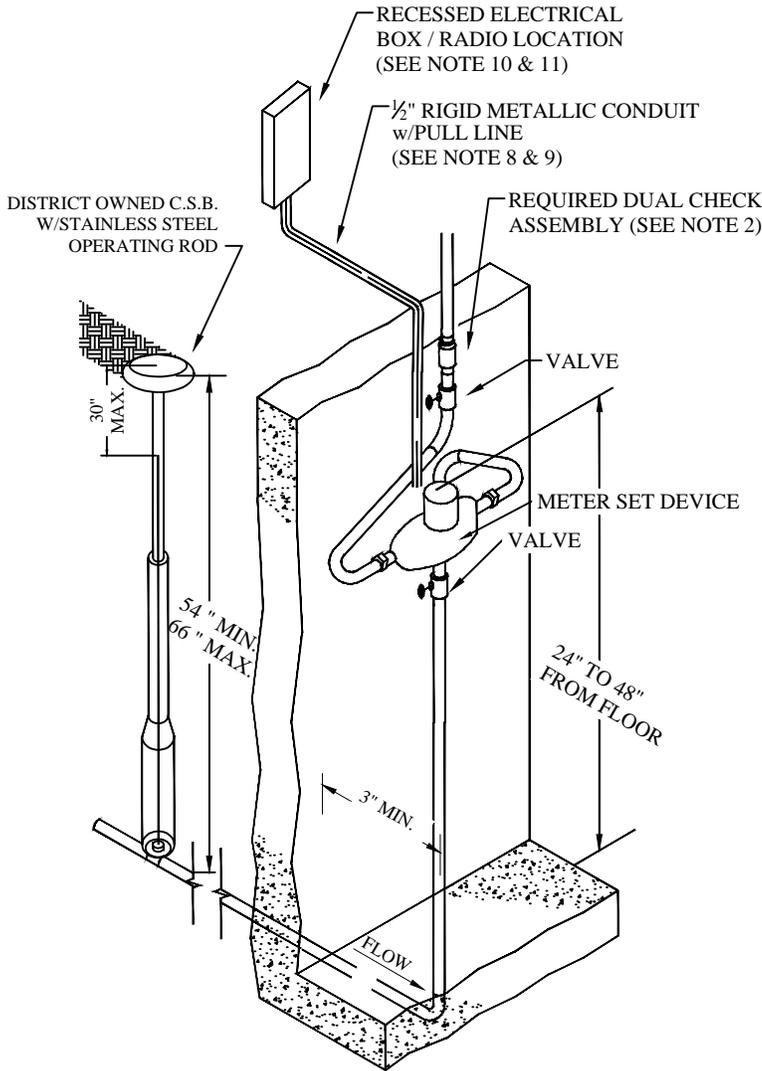

Meter Installation Address _____ City: _____
 (Return or fax form to District, meters will typically be set within 2 business days after receiving the request form.)

Builder Certification: (By signing, you are certifying that all District meter set requirements have been met. You also understand that you will be subject to minimum \$50.00 re-set fee if meter is not set due to non-conformance items.)

Company Name: _____ Superintendent: _____
 Address: _____ Superintendent Signature: _____
 City: _____ State: _____ Zip: _____ Phone #: _____